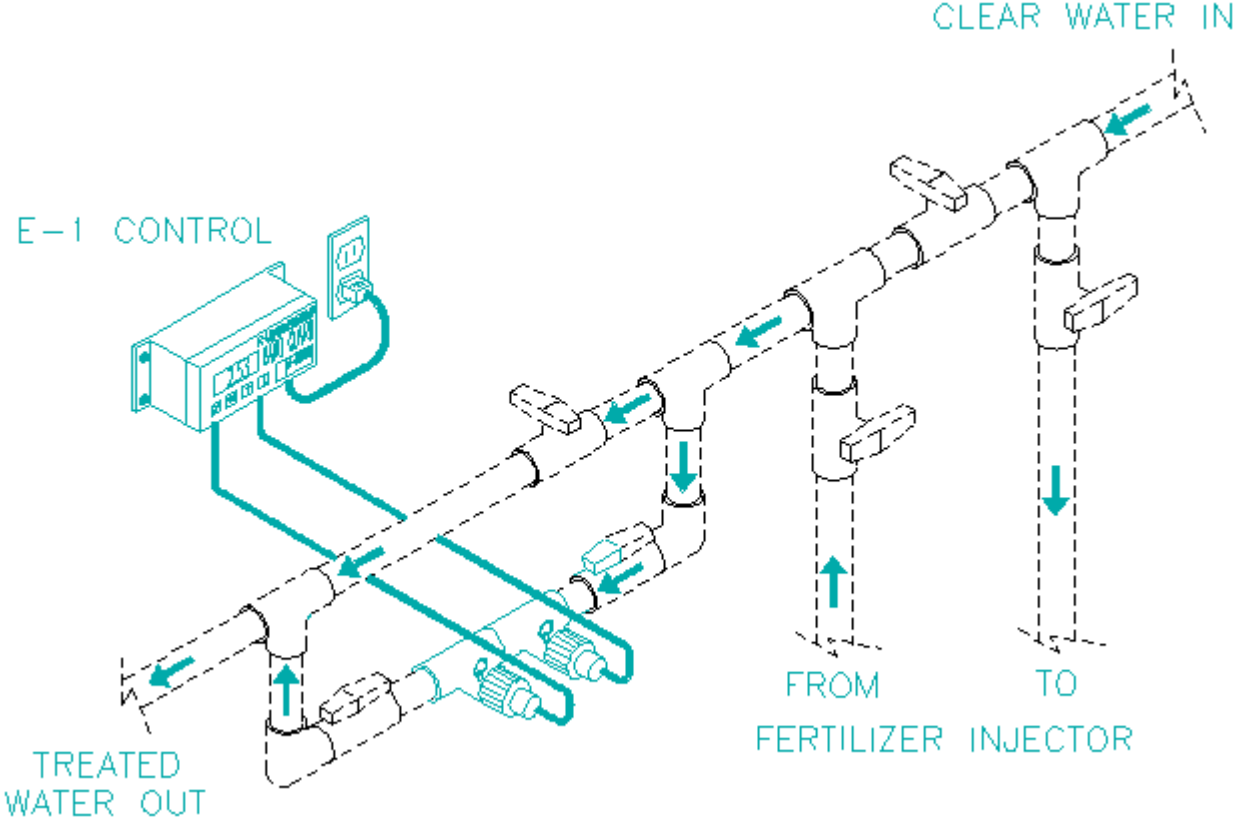
CLEAR WATER IN
E-1 CONTROL
FROM
FERTILIZER
TO
INJECTOR
TREATED
WATER OUT